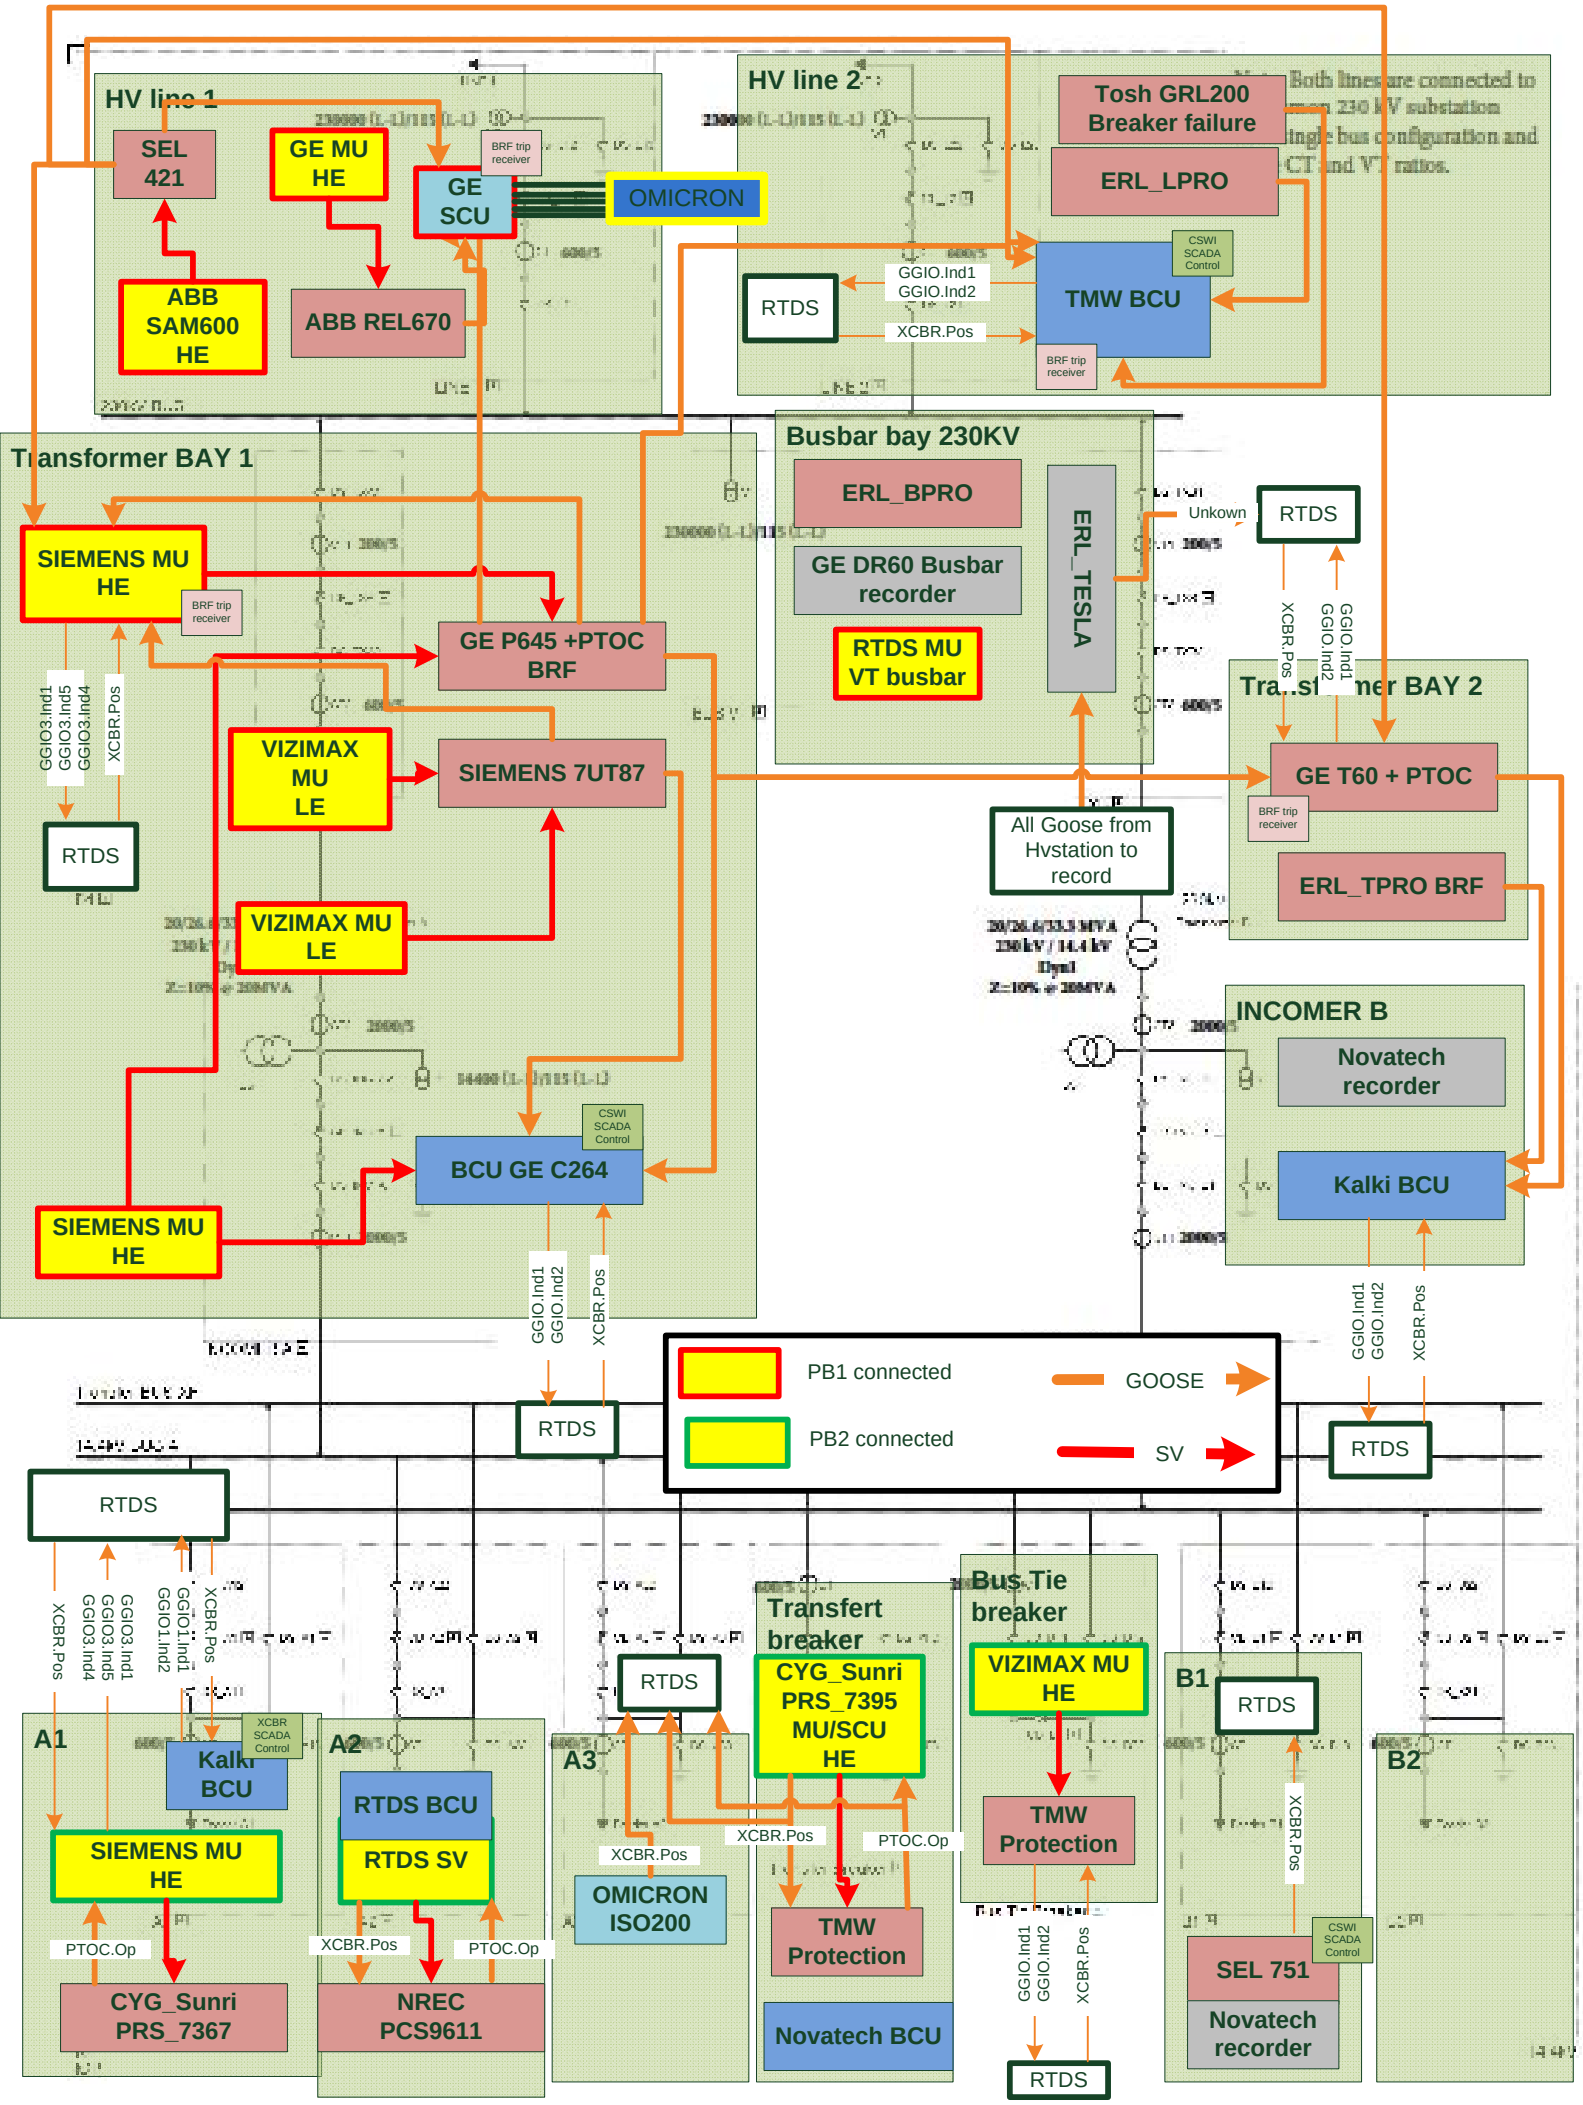
HV line 1
SEL 421
GE MU HE
GE SCU
BRF trip receiver
OMICRON
ABB SAM600 HE
ABB REL670
HV line 2
Tosh GRL200 Breaker failure
ERL_LPRO
CSWI SCADA Control
TMW BCU
RTDS
GGIO.Ind1
GGIO.Ind2
XCBR.Pos
BRF trip receiver
Busbar bay 230KV
ERL_BPRO
GE DR60 Busbar recorder
RTDS MU VT busbar
ERL_TESLA
Unkown
RTDS
Transformer BAY 1
SIEMENS MU HE
BRF trip receiver
GE P645 +PTOC BRF
GGIO3.Ind1
GGIO3.Ind5
GGIO3.Ind4
XCBR.Pos
VIZIMAX MU LE
SIEMENS 7UT87
RTDS
VIZIMAX MU LE
CSWI SCADA Control
BCU GE C264
SIEMENS MU HE
GGIO.Ind1
GGIO.Ind2
XCBR.Pos
Transformer BAY 2
GE T60 + PTOC
BRF trip receiver
ERL_TPRO BRF
All Goose from Hvstation to record
INCOMER B
Novatech recorder
Kalki BCU
PB1 connected
PB2 connected
GOOSE
SV
RTDS
RTDS
RTDS
Transfert breaker
CYG_Sunri PRS_7395 MU/SCU HE
Bus Tie breaker
VIZIMAX MU HE
TMW Protection
A1
Kalki BCU
XCBR SCADA Control
SIEMENS MU HE
PTOC.Op
CYG_Sunri PRS_7367
A2
RTDS BCU
RTDS SV
XCBR.Pos
PTOC.Op
NREC PCS9611
A3
RTDS
OMICRON ISO200
XCBR.Pos
PTOC.Op
TMW Protection
Novatech BCU
B1
RTDS
SEL 751
Novatech recorder
CSWI SCADA Control
B2
RTDS